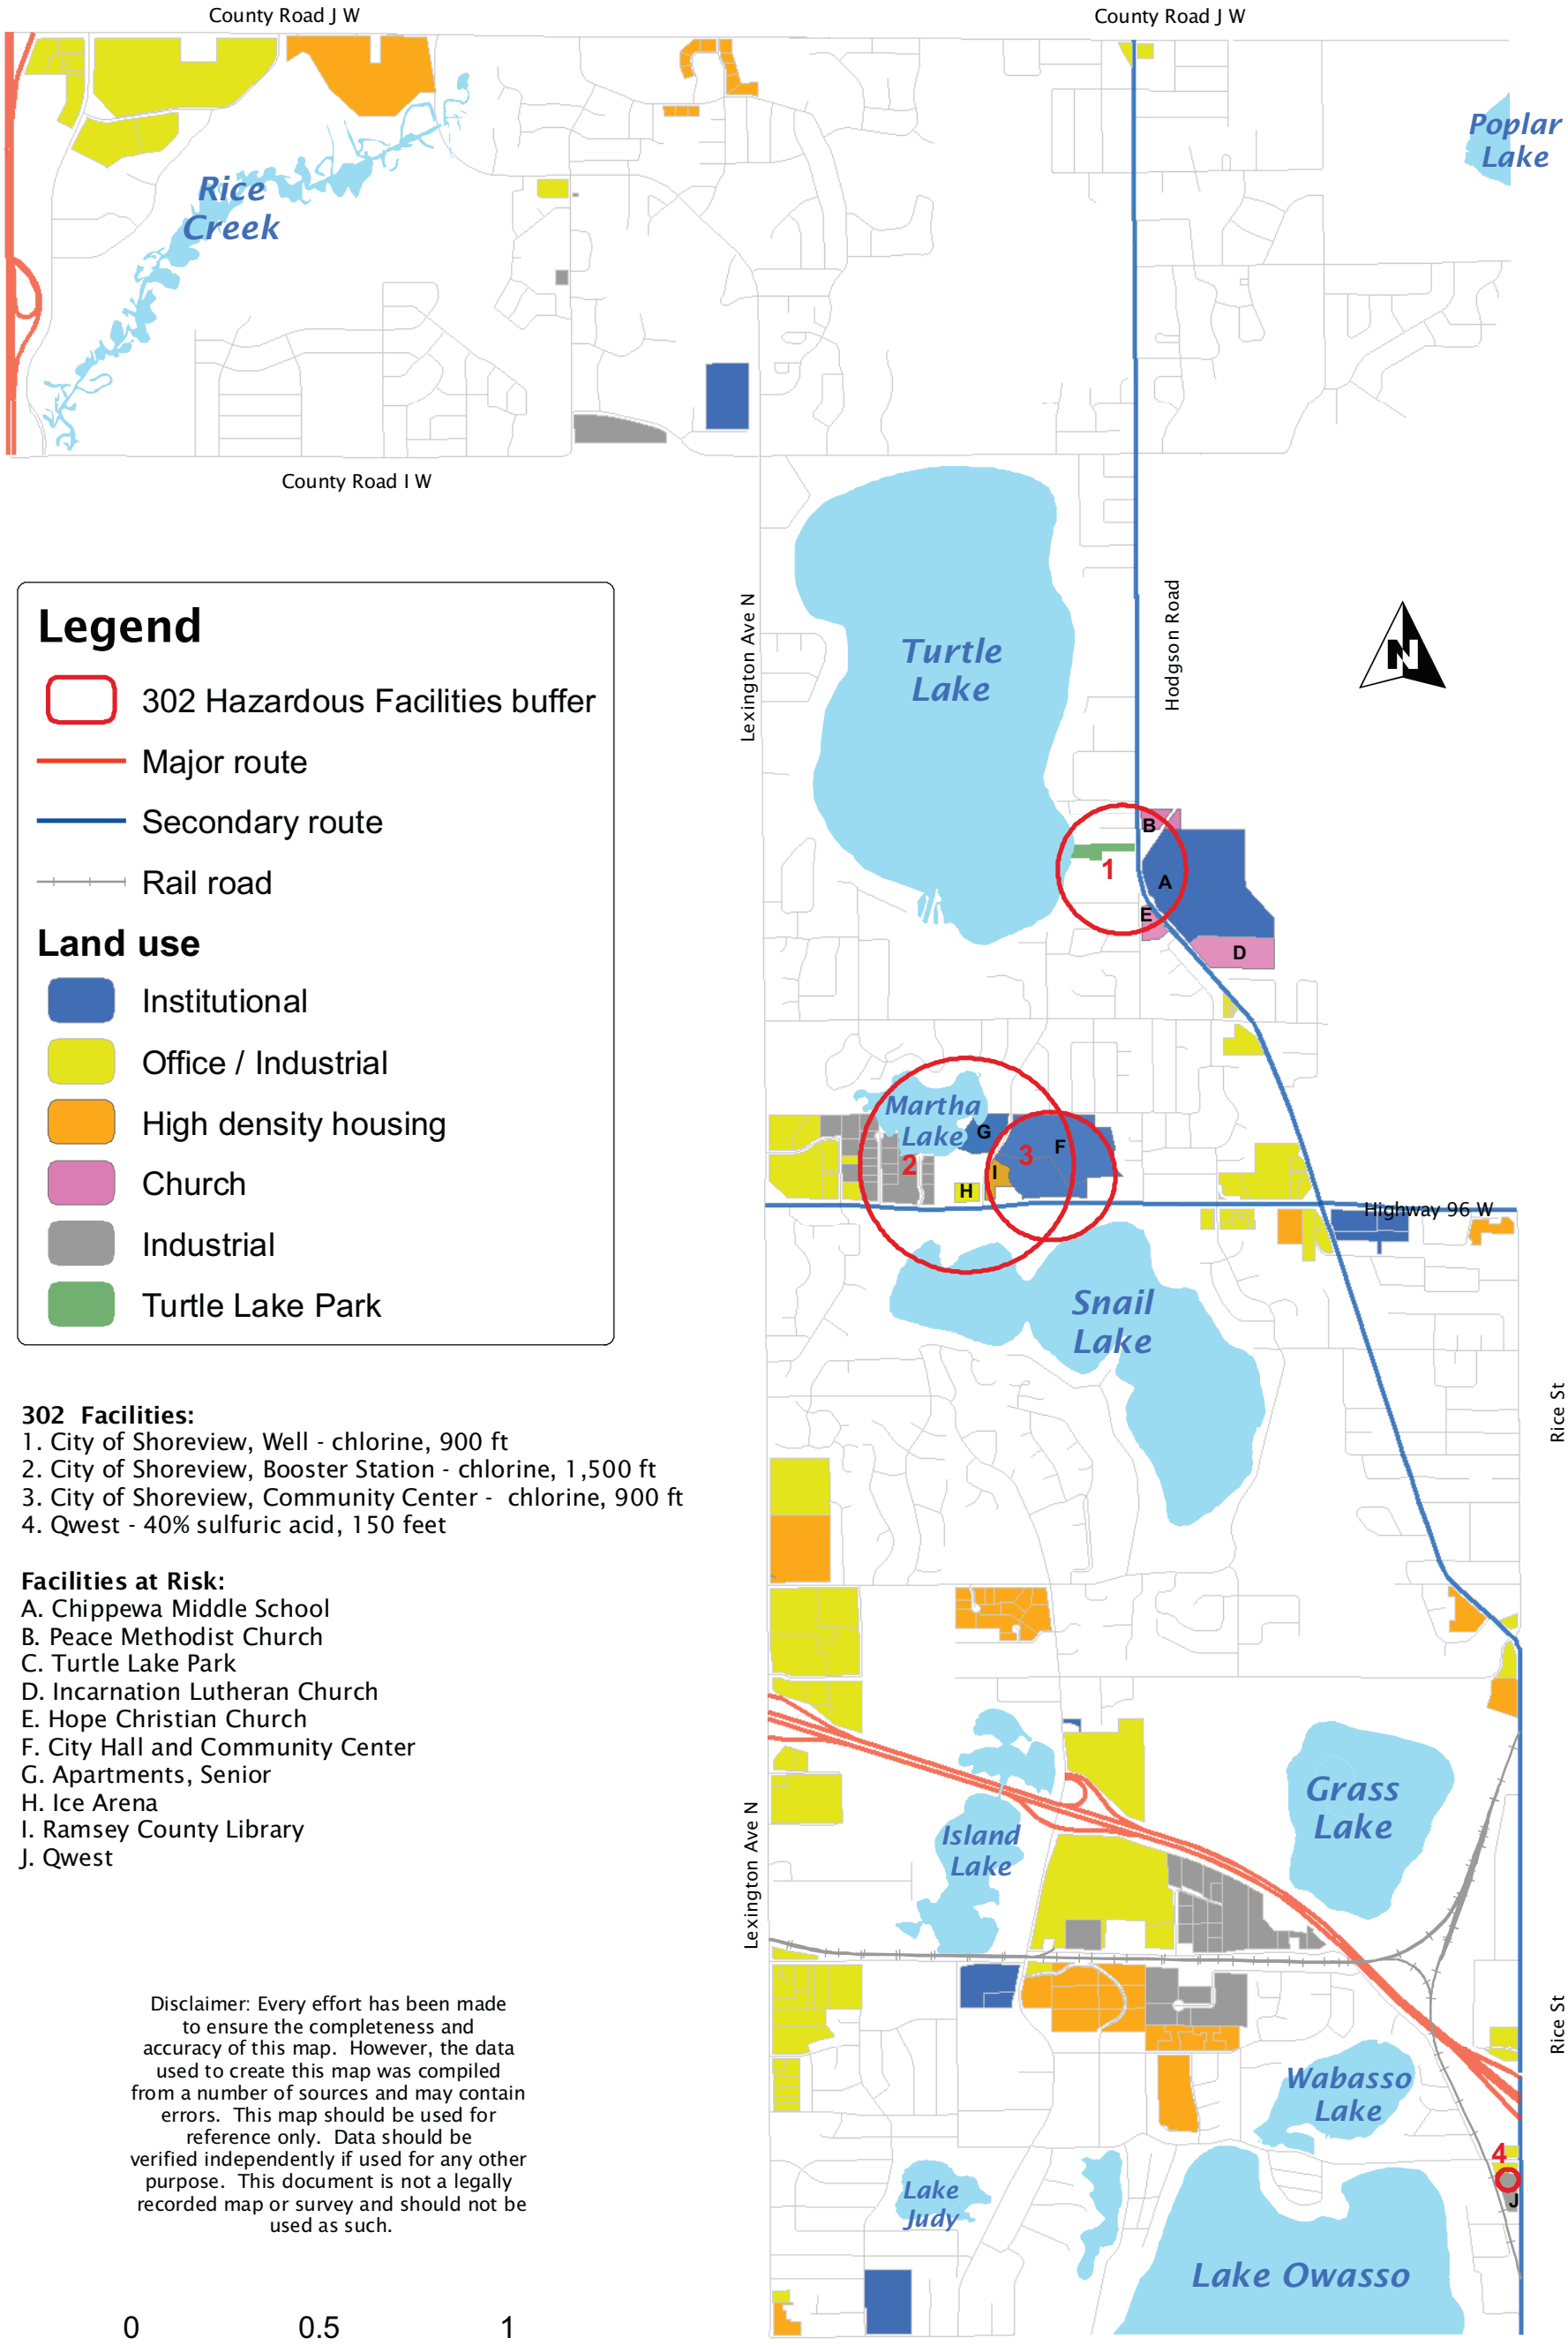

302 Facilities:
1. City of Shoreview, Well - chlorine, 900 ft
2. City of Shoreview, Booster Station - chlorine, 1,500 ft
3. City of Shoreview, Community Center - chlorine, 900 ft
4. Qwest - 40% sulfuric acid, 150 feet

Facilities at Risk:
A. Chippewa Middle School
B. Peace Methodist Church
C. Turtle Lake Park
D. Incarnation Lutheran Church
E. Hope Christian Church
F. City Hall and Community Center
G. Apartments, Senior
H. Ice Arena
I. Ramsey County Library
J. Qwest

Disclaimer: Every effort has been made to ensure the completeness and accuracy of this map. However, the data used to create this map was compiled from a number of sources and may contain errors. This map should be used for reference only. Data should be verified independently if used for any other purpose. This document is not a legally recorded map or survey and should not be used as such.

9F.2 Location of hazardous materials and facilities at risk

City of Shoreview - 2008 Comprehensive Plan

Shoreview

October 20, 2008